

40' container
PV-modules




Power-tower

----- power-line

R9	294 628.885	1919 389.493
R10	294 603.918	1919 418.743
R11	294 599.141	1919 419.852

GRID U T M ZONE 16 IN METRES

STATIONS	EASTINGS	NORTHINGS
Fd.1'	294 795.920	1919 446.805
Fd.2'	294 792.399	1919 441.829
Fd.3'	294 752.274	1919 463.280
S1	294 742.468	1919 470.110
S2	294 715.263	1919 483.693
S3	294 673.873	1919 498.053
S4	294 664.597	1919 496.369
Fd.4'	294 632.697	1919 435.274
Fd.5'	294 669.910	1919 416.601
Fd.6'	294 697.312	1919 380.535
Fd.7'	294 736.589	1919 354.029
Fd.8'	294 770.441	1919 329.407
Fd.9'	294 830.255	1919 414.845
Fd.10'	294 866.608	1919 466.356
Fd.11'	294 885.315	1919 492.492
S5	294 810.107	1919 545.666
S	294 758.658	1919 473.159
R1'	294 748.703	1919 480.202
R2'	294 804.144	1919 558.349
R3'	294 771.619	1919 577.926
Fd.9'	294 719.960	1919 494.549

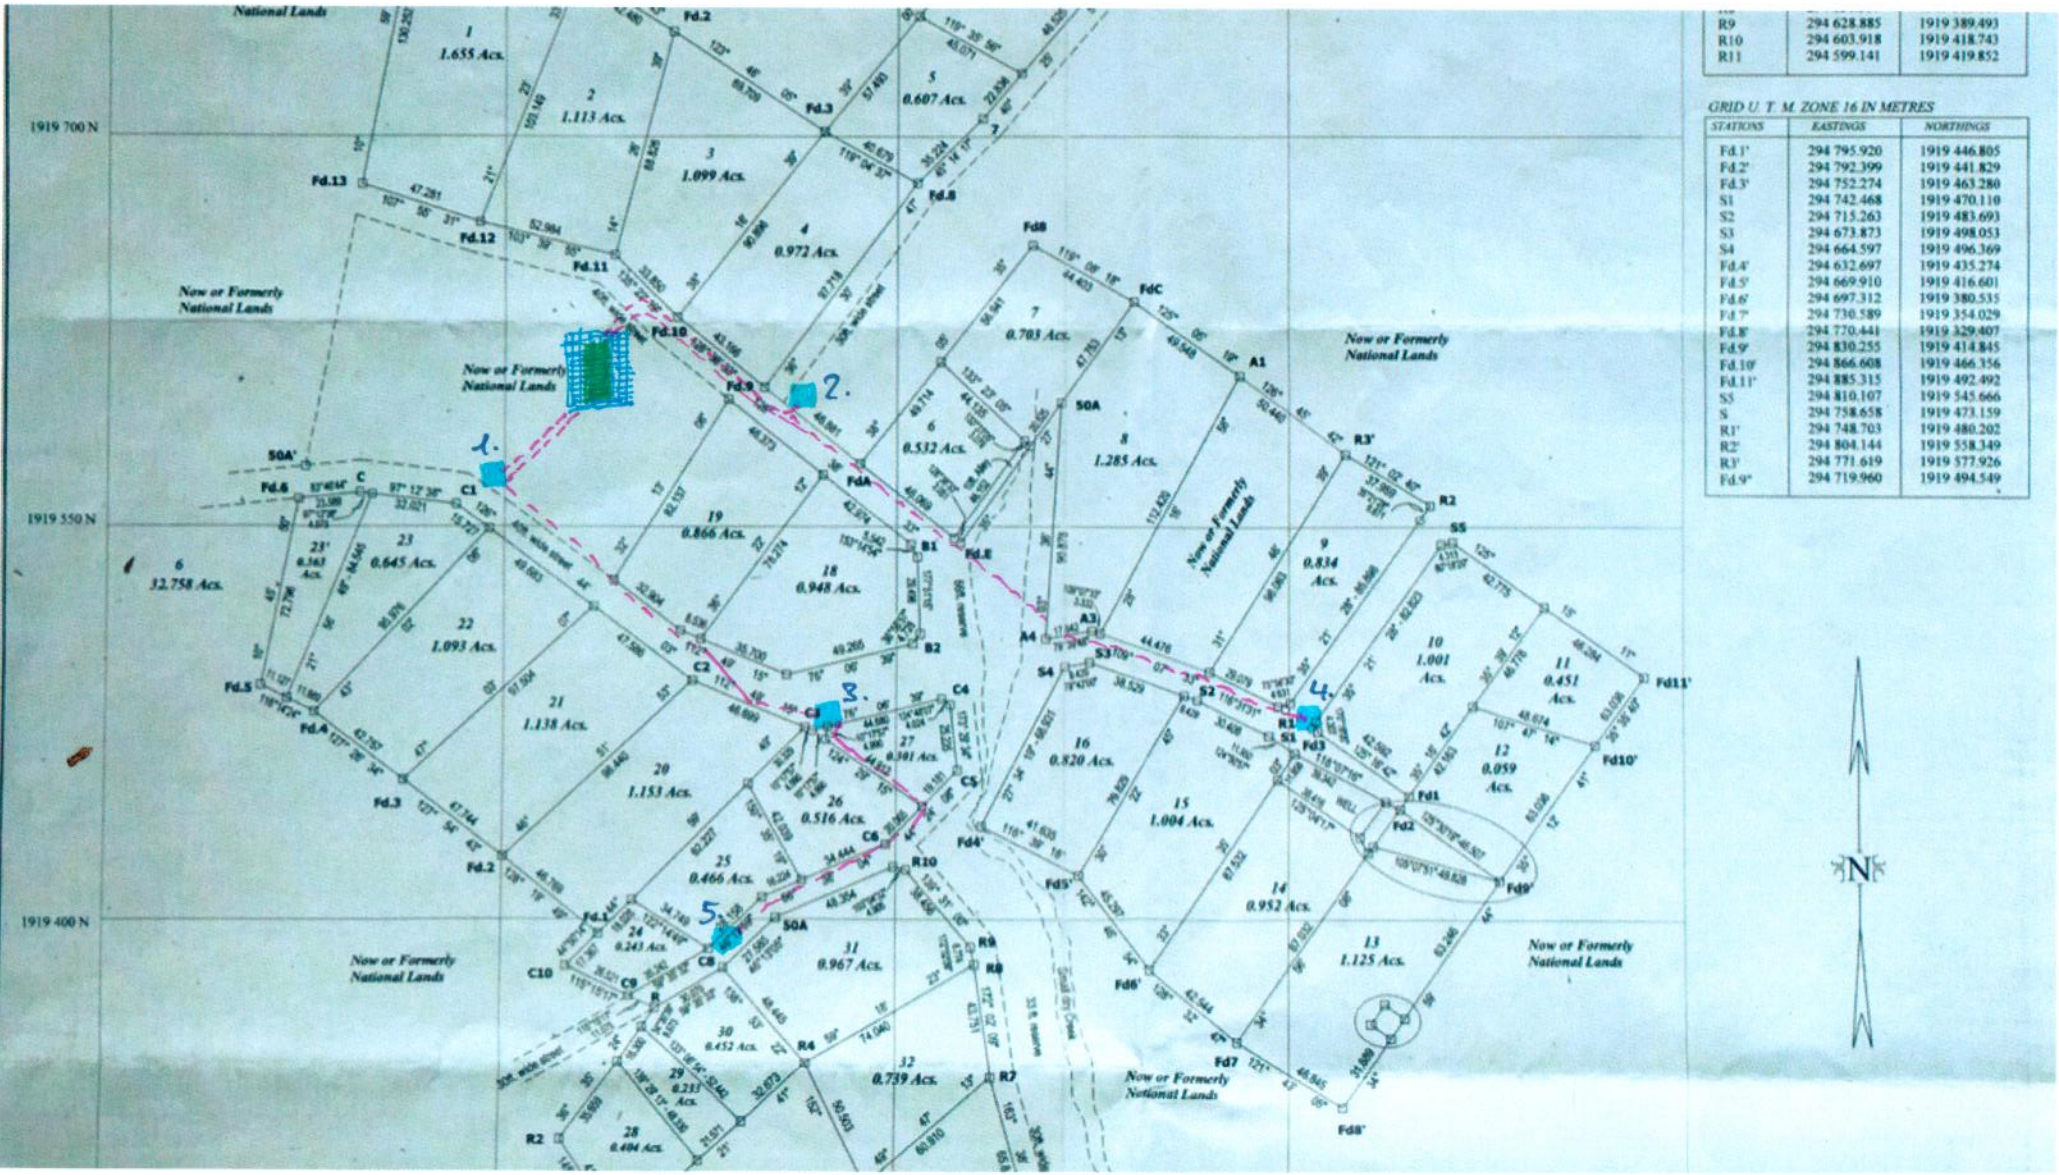

1919 700 N

1919 550 N

1919 400 N

